



FET SWITCH 1

Inrush &
PSU short
circuit output

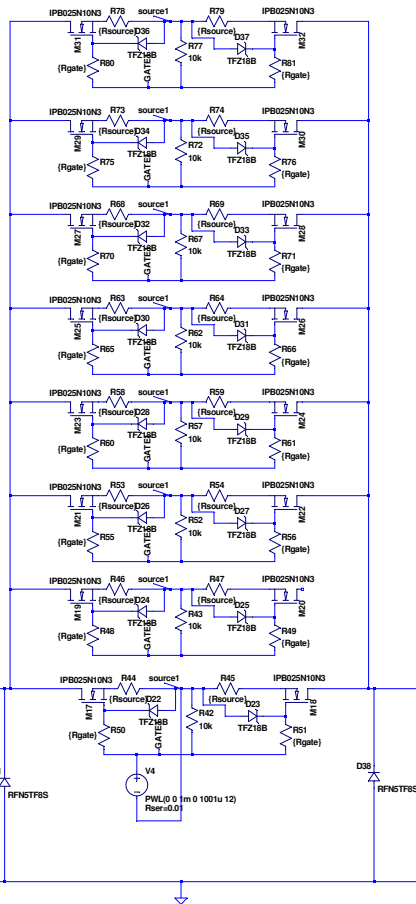

FET SWITCH 2

Load Transients
& PSU failure

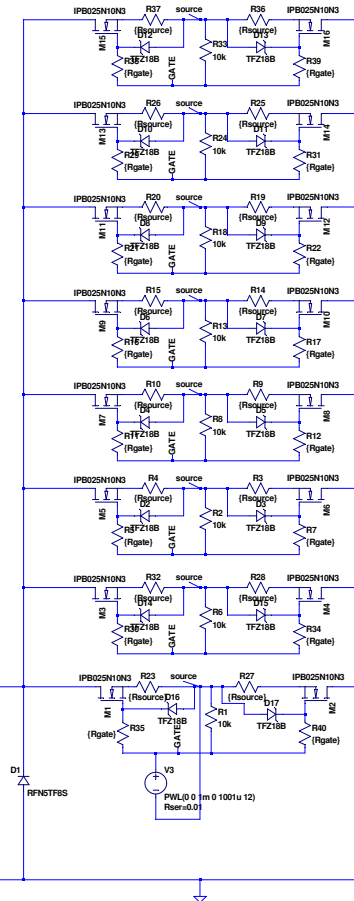

.param Rsource 0.00001

.param Rgate 100

240A NOMINAL
MAX LOAD
CURRENT
(but bigger transients)

REVERSE
CURRENT
MONITOR

LOAD 12kW
but bigger
transients